


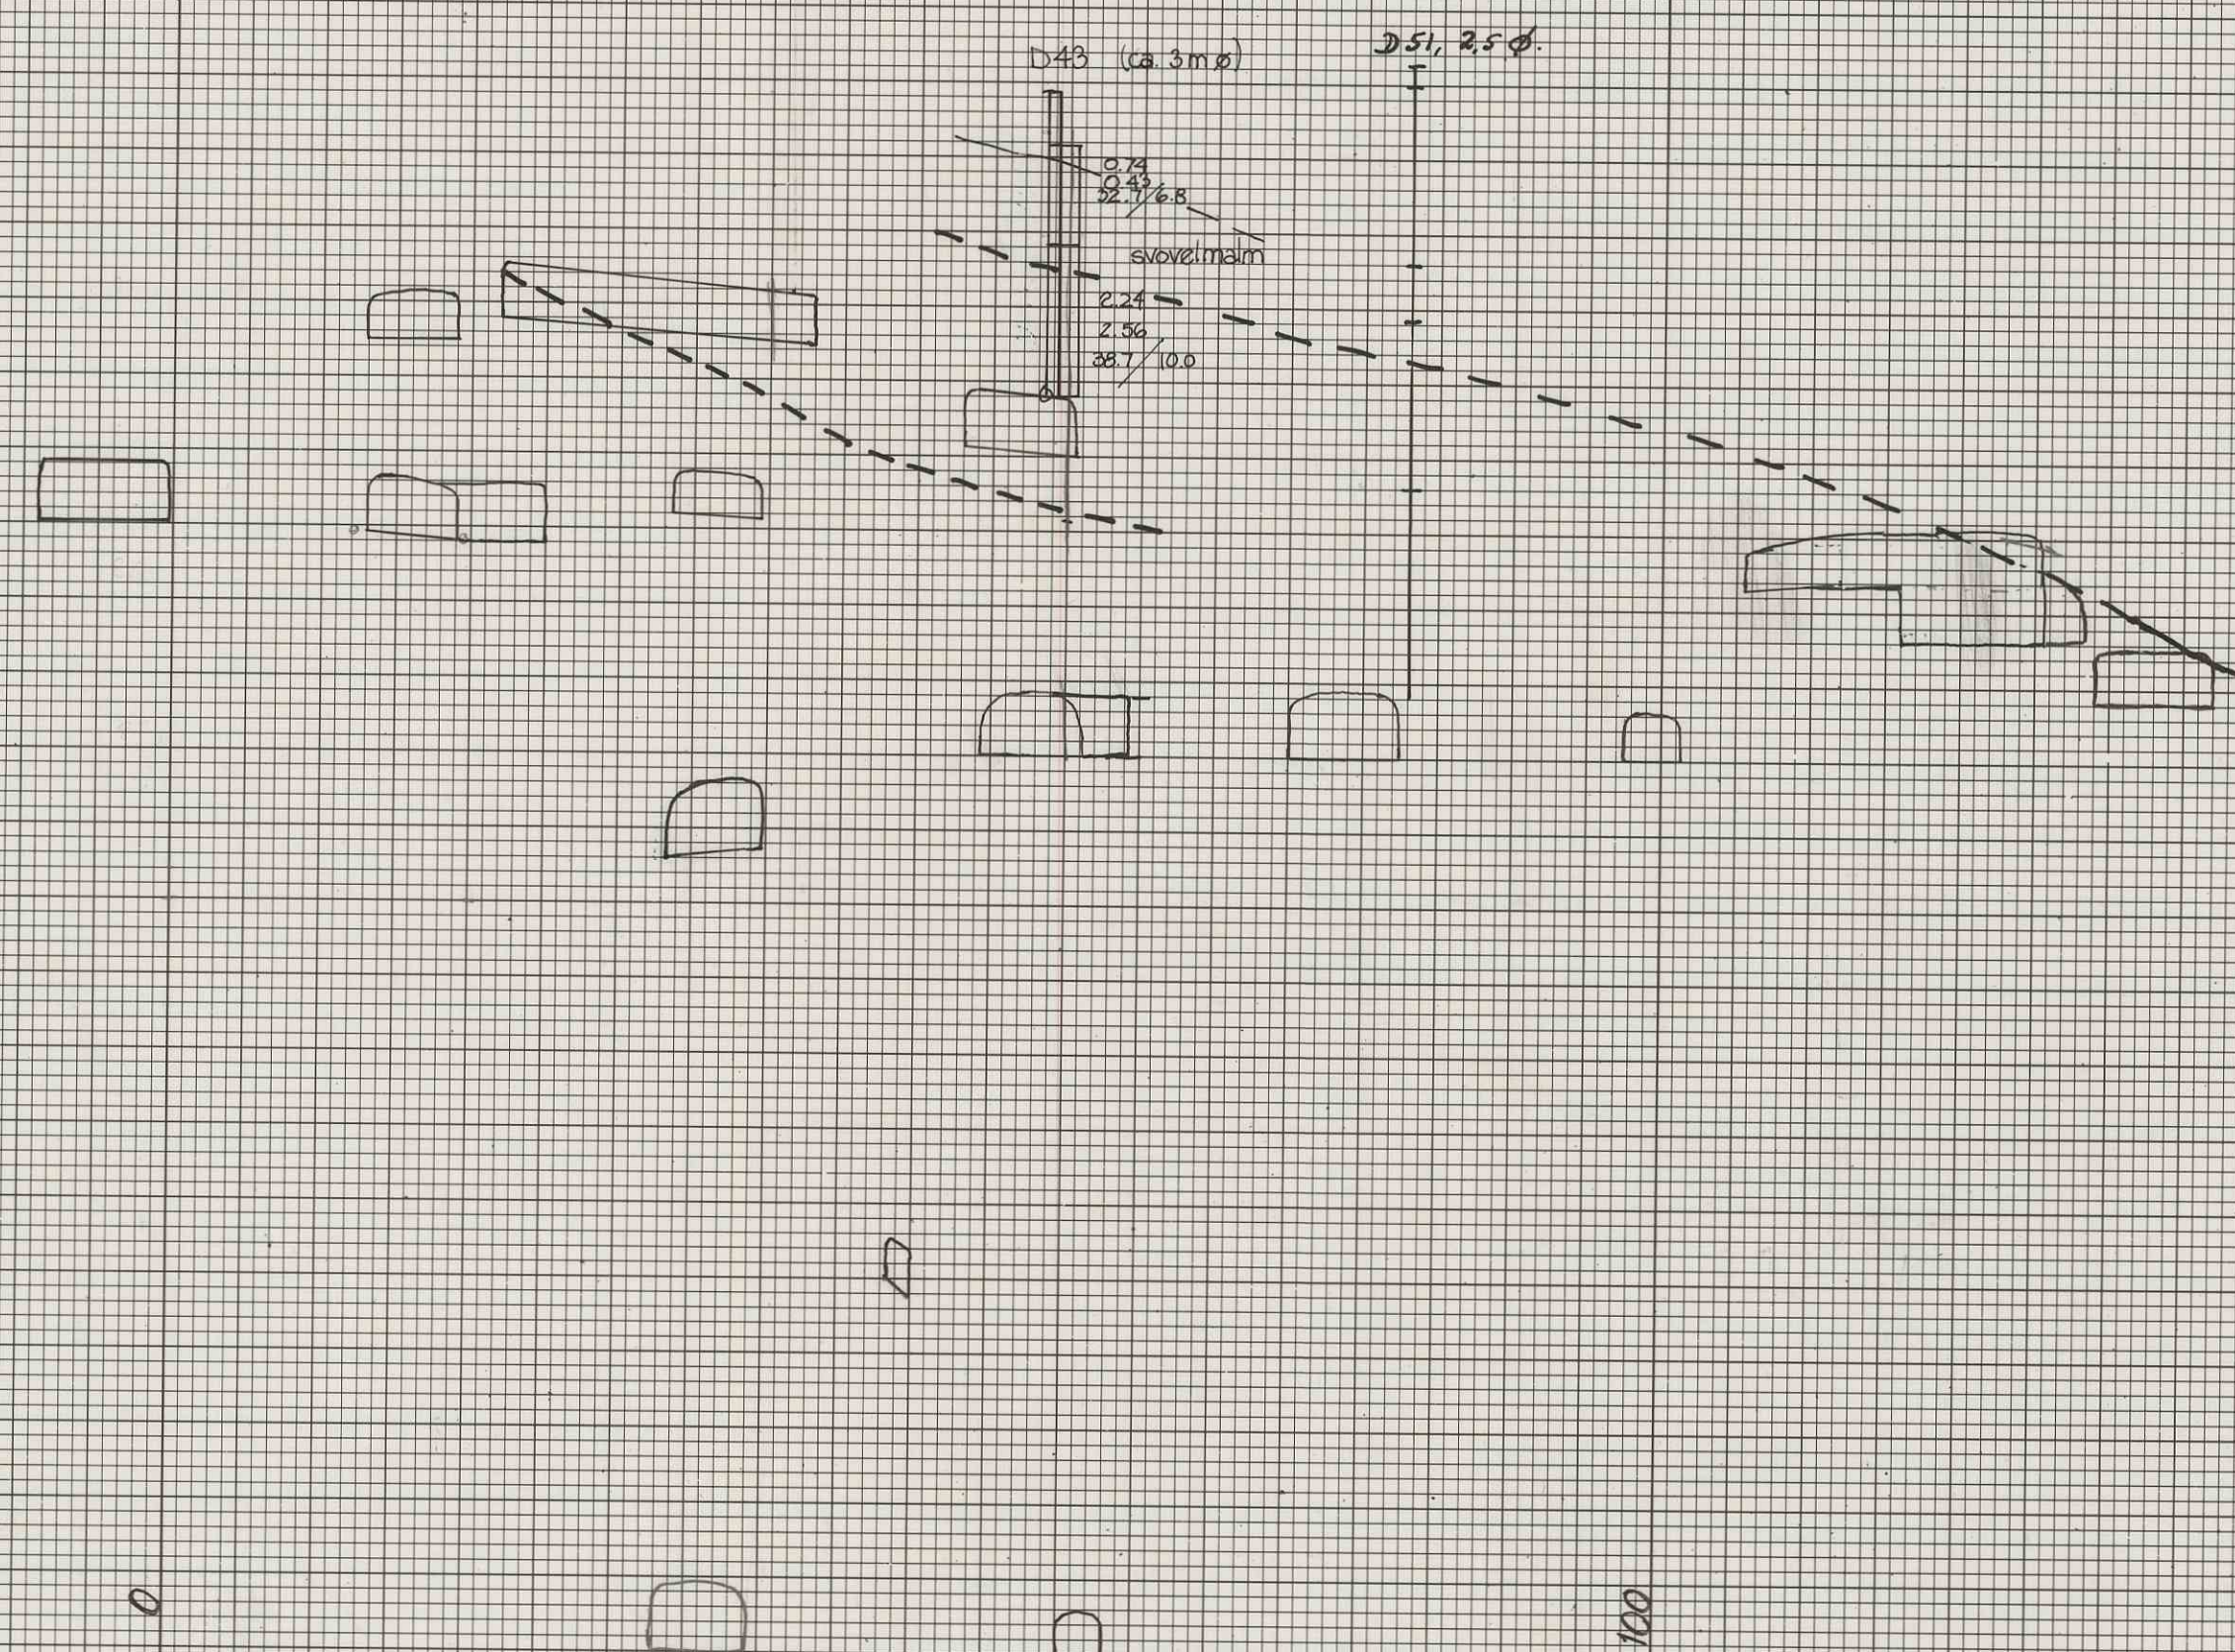

930

TEGNFORKLARING

Malmgrense, sikker/usikker
Viser malm over cut-off-verdi
jan. 82

svovelmalmgrænse
svovelmalm har pr. def. mindst 35% S

D5
2.0
0.9
2.0
1.5
bor hull nr D5 med gjennomsnittsgjæter
Cu: 2.0%, Zn: 0.9%, S: 23%
over 15 meter


 Vasskris

 Leirsleppa

5627

BØKKEN GRUBER 1/5800	M. =	AJOUR	Aug. 82
		11	
		1111	
ASTRUP GRUBEOMRÅDE	1:500		
B)	PROFIL 113-b		
	B.1		