


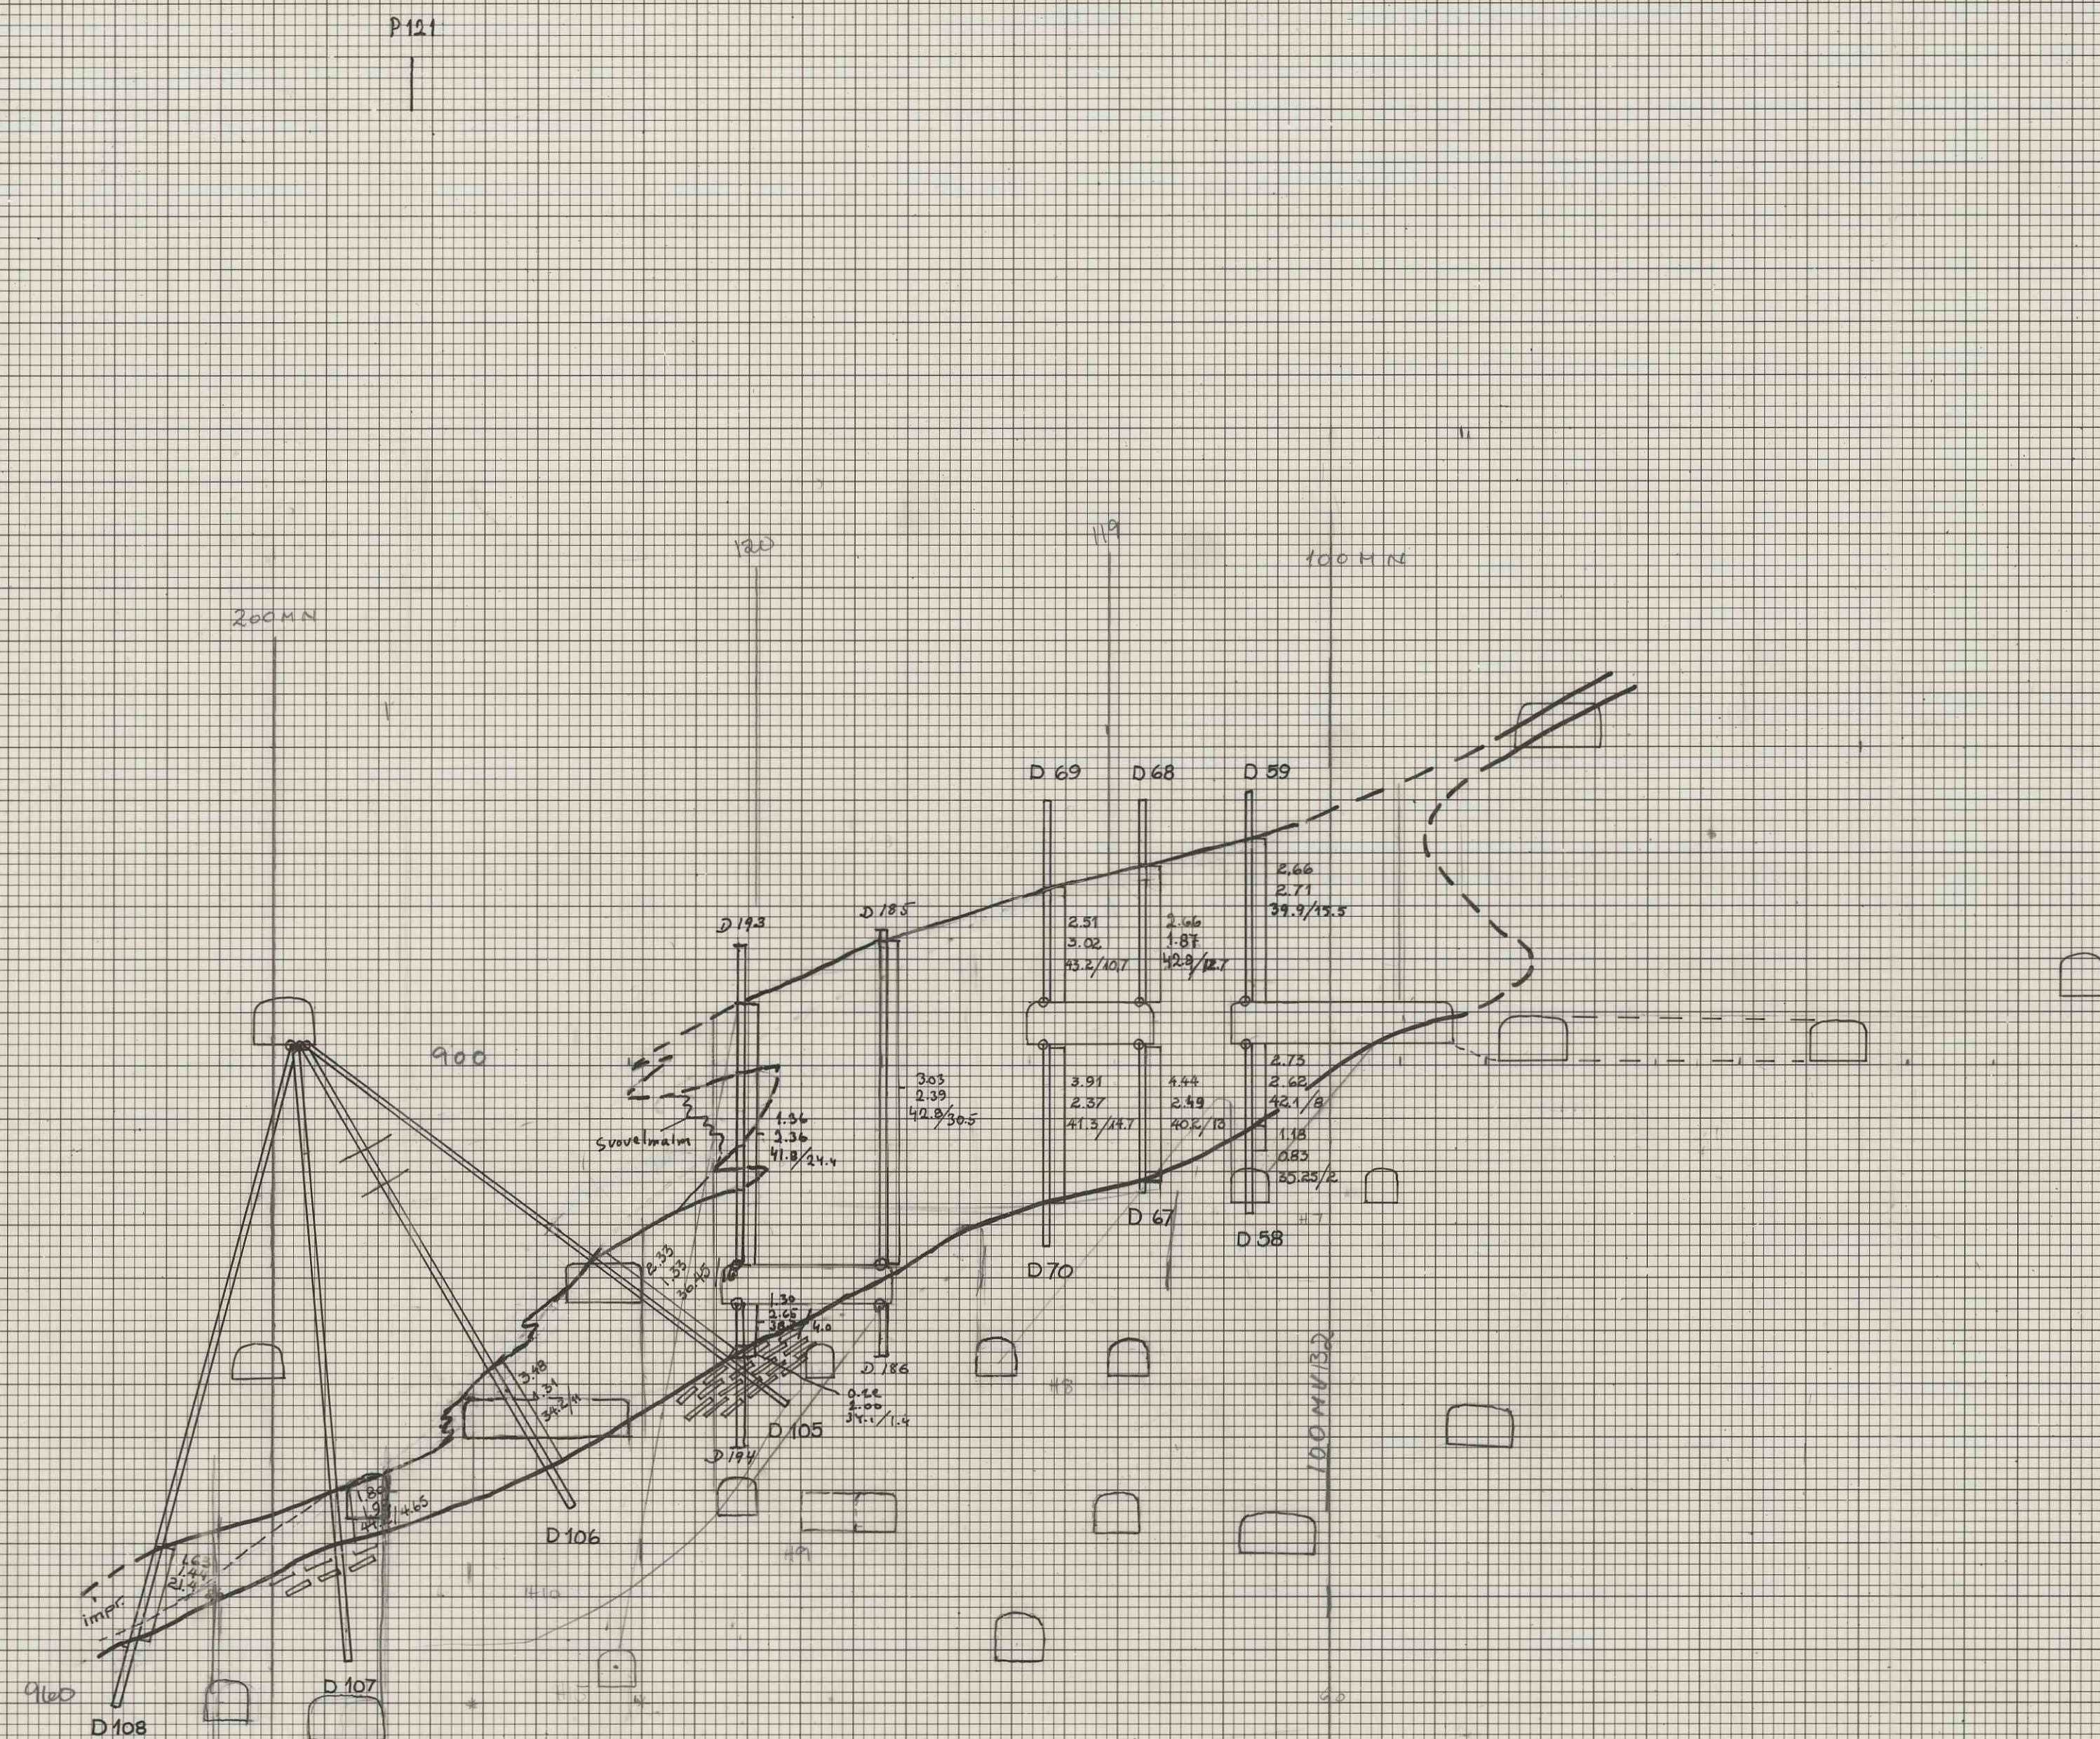

Borhull nr.	g/t Ag i malm o cut-off
D 105	16.4
D 106	23.6
D 107	18.7
D 108	16.9

TEGNFORKLARING

--- Malmgrense, sikker/usikker.
 Viser malm over cut-off-verdi jan. 82.

--- Svovelmalmgrense
 Svovelmalm har pr. def. minst 35% S

D5 Borhull nr. D5 med gennemsnitsgehalt:
 Cu: 2.0%, Zn: 0.9%, S: 23%
 over 15 meter

--- Vasskis
 --- Leirsleppa

5678

LØKKEN GRUBER A/S & Co.	M	AJOUR 16.2.-82
ASTRUP GRUVEOMRÅDE	1:500	- W -
R.J./Å.B.	PROFIL 212 B2	