
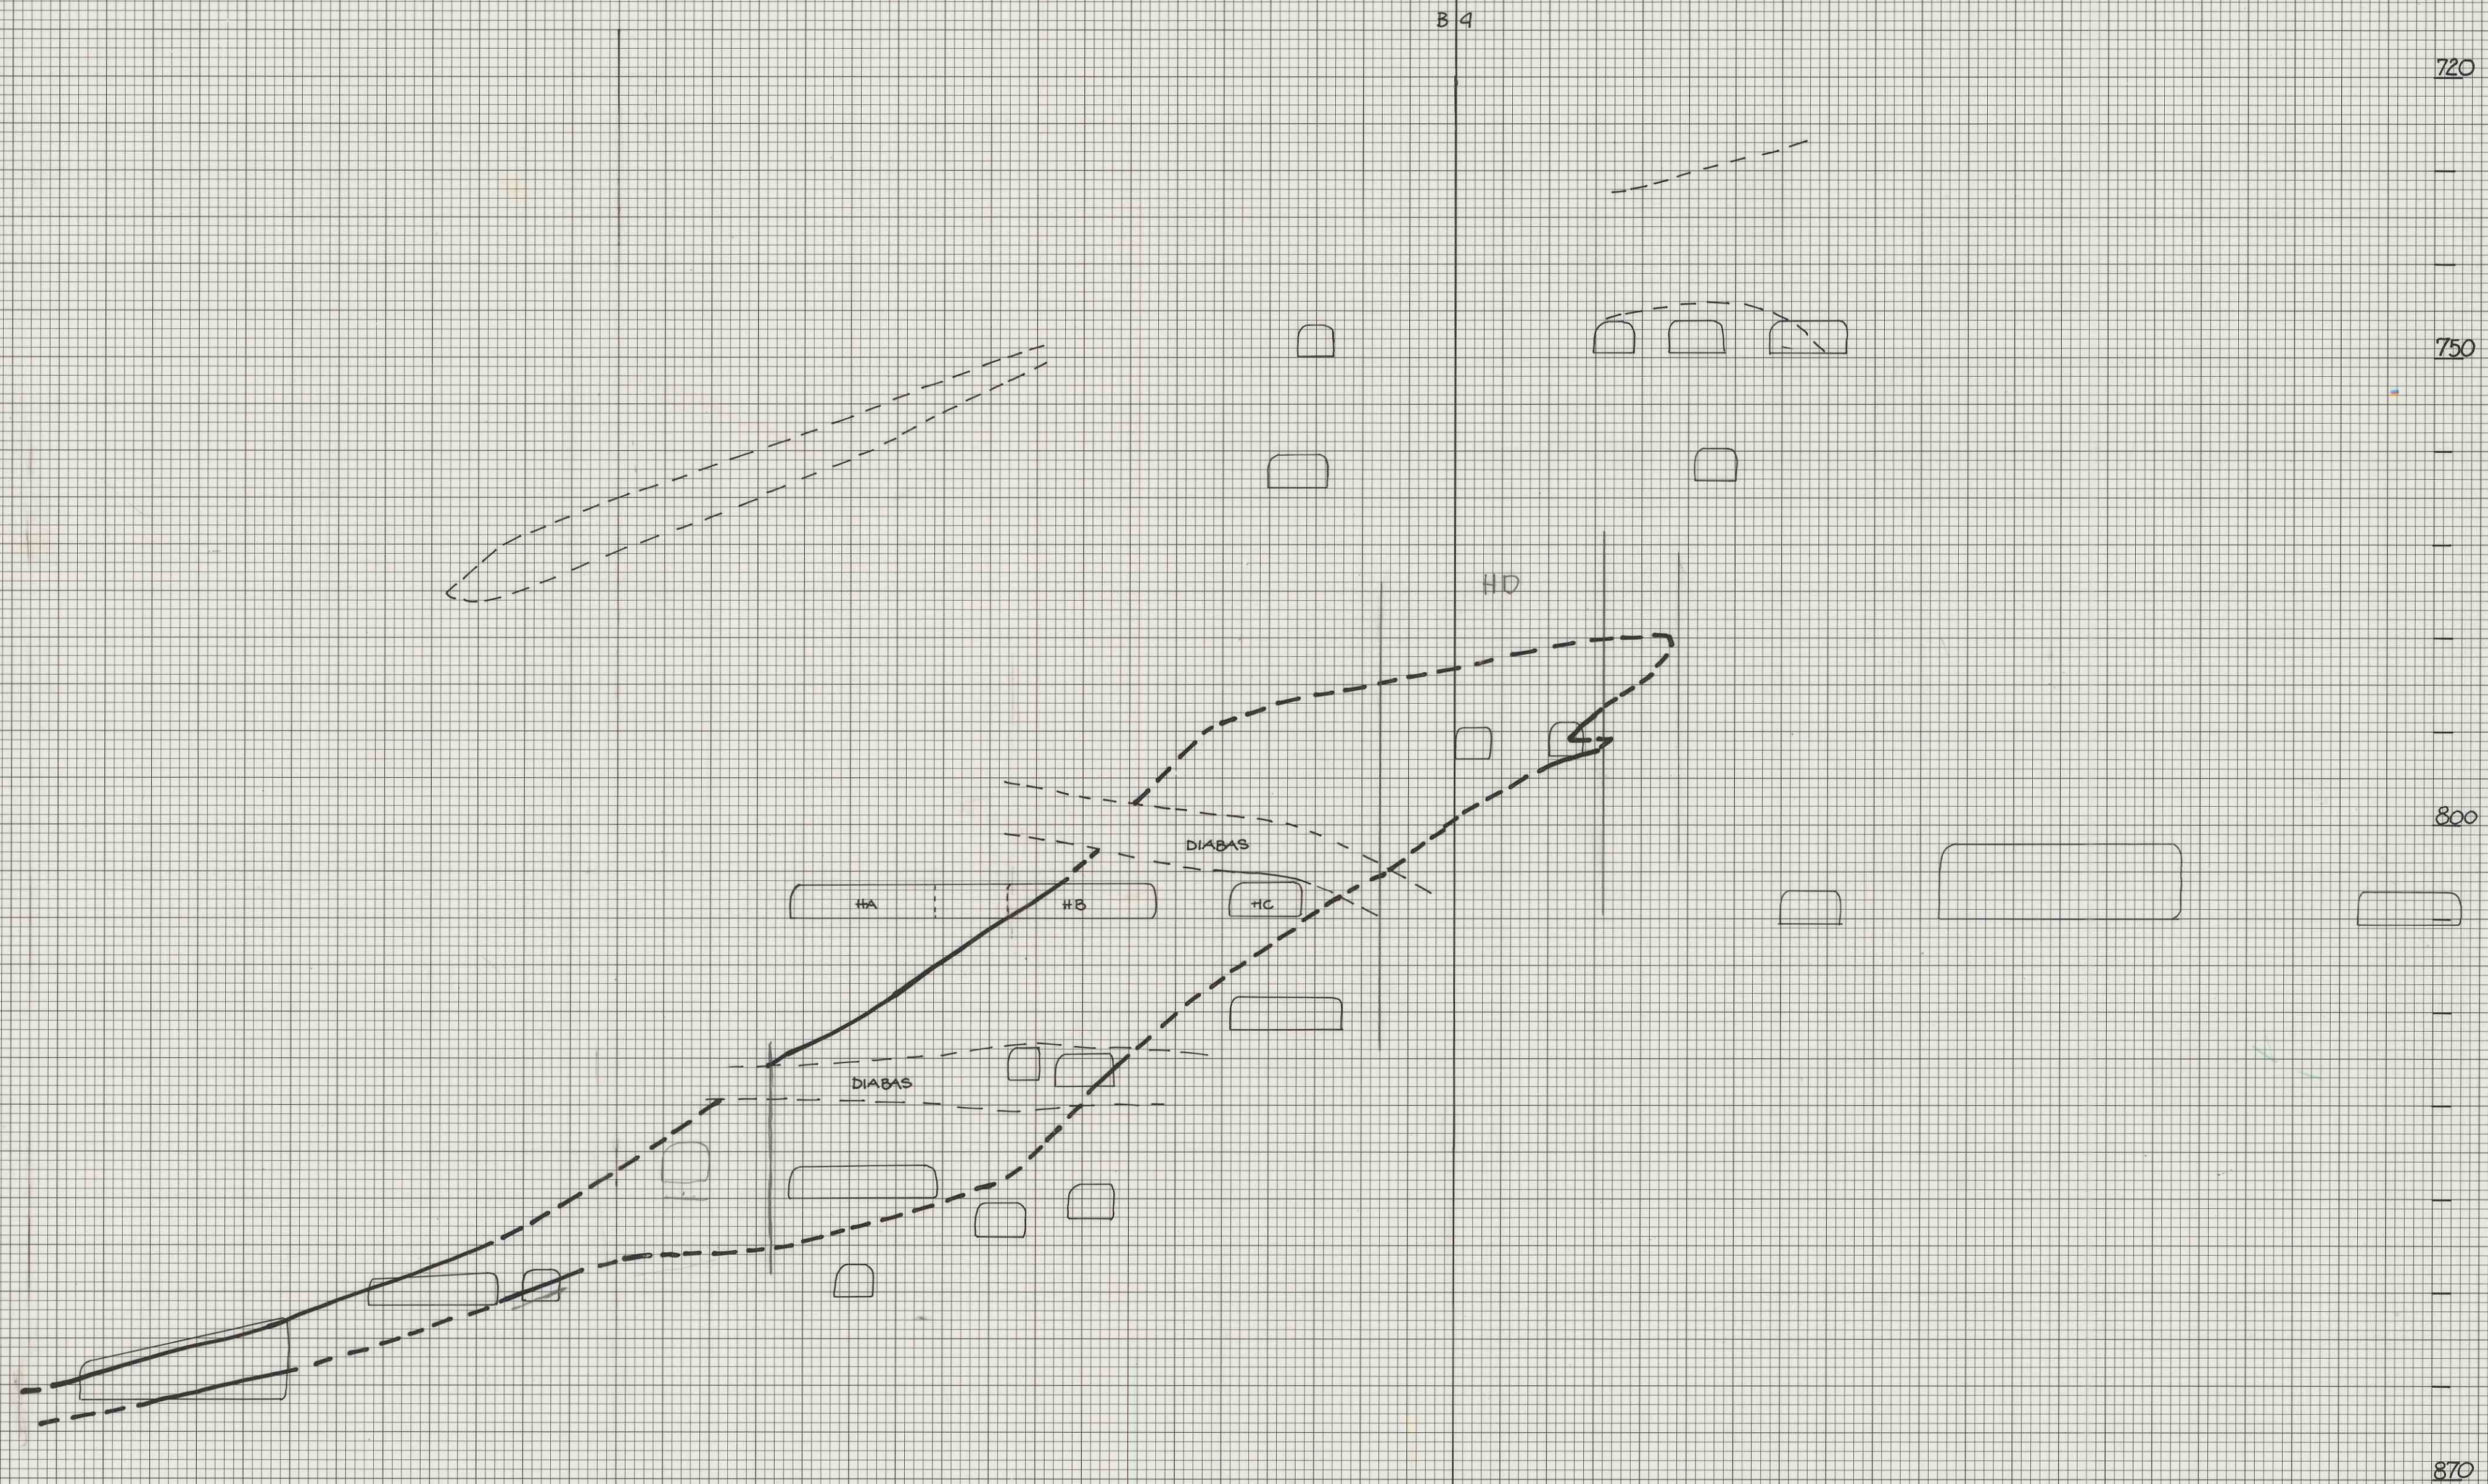






TEGNFORKLARING

 Malmgrense, sikker/usikker
 Viser malm over cut-off-verdi
 jan.82

 Svoelmalmgrense
 Svoelmalm har pr def. minst 25% s

 Bor hull nr. D5 med gennemsnittsgehalter:
 Cu: 2.0%, Zn: 0.9%, S: 23.0%
 over 15 meter

 Vasekis
 Leirsleppa

5767

LØKKEN GRUBER A/S & Co	M	AJOUR	13-04-83 AM
ASTRUP GRUBEOMRÅDE	1:500	- 11 -	
ArH	PROFIL 403		
	B4		